

XP95

Heat Detector



Product overview

Product	Heat Detector - A2S
Part No.	55000-400
Product	Heat Detector - A2S
Part No.	55000-420
Product	Heat Detector - CS
Part No.	55000-401
Digital communication	XP95, Discovery and CoreProtocol® compatible

Compliance*



Note: *

55000-400; CPR, LPCB only

55000-420; CPR, LPCB, VdS, BOSEC, SBSC, CCMG, FG

55000-401; CPR, LPCB, BOSEC, CCMG, SBSC, only

Product information

The XP95 Heat Detector monitors temperature by using a single thermistor which provides a count output proportional to the external air temperature.

- Ideal for environments that are dirty or smoky under normal circumstances
- Unaffected by wind or atmospheric pressure

Technical data

All data is supplied subject to change without notice. Specifications are typical at 24 V, 25°C and 50% RH unless otherwise stated.

Detection principle	Linear approximation over temperature range 25°C to 90°C
Sensor	Single NTC thermistor
Sampling frequency	Continuous
Sensitivity	90 °C: 55 counts
Supply Wiring	Two wire supply, polarity insensitive
Terminal functions	L1 & L2 Loop in & out positive +R Remote indicator positive connection (internal 2.2 kΩ resistance to supply +ve) -R Remote indicator negative connection (internal 2.2 kΩ resistance to supply -ve)
Supply voltage	17 V to 28 V dc
Digital communication	XP95, Discovery and CoreProtocol compatible
Modulation voltage	5 V - 9 V peak to peak
Quiescent current	300 µA
Power-up surge current	1mA
Duration of power-up surge current	0.3 seconds
Max power-up time	4 seconds
Analogue value at 25°C	25 ± 5 counts
Alarm indicator	Red light emitting diode (LED)
Alarm LED current	4 mA
Remote LED current	Internal 4.5 k to +ve line (5 mA max)
Storage temperature	-30°C to +80°C
Operating temperature	-20°C to +70°C
Humidity (no condensation or icing)	0% to 95% RH)
Effect of atmospheric pressure	None
Effect of wind speed	None in fixed temperature use
Vibration, impact and shock	To EN 54 - 5
IP Rating	IP54
Standards and approvals*	EN54, CPR, LPCB, VdS, BOSEC, SBSC, CCMG, FG
Dimensions	100mm diameter x 42 mm height
Weight	105 g
Material	Housing: White flame retardant polycarbonate Terminals: Nickel plated stainless steel

36 Brookside Road, Havant
Hampshire, PO9 1JR, UK.

Tel: +44 (0)23 9249 2412
Fax: +44 (0)23 9249 2754

Email: sales@apollo-fire.com
Web: www.apollo-fire.co.uk

All information in this document is given in good faith but Apollo Fire Detectors Ltd cannot be held responsible for any omissions or errors. The company reserves the right to change the specifications of products at any time and without prior notice.



Operation

The XP95 Heat Detector has a common profile with the XP95 optical smoke detectors but has a low air flow resistance case made of white polycarbonate.

The device monitors heat using a single thermistor network which provides a voltage output proportional to the external air temperature.

Electrical description

The Heat Detector is designed to be connected to a two wire loop circuit carrying both data and a 17 V to 28 V dc supply. The detector is connected to the incoming and outgoing supply via terminals L1 and L2 in the mounting base. A remote LED indicator requiring not more than 4 mA at 5V may be connected between the +R and -R terminals. An earth connection terminal is also provided. The detector is calibrated to give an analogue value of 25 ± 5 counts at 5°C . This value increases with rising temperature. A count of 55 corresponds to the EN 54 alarm sensitivity level.

When the detector is energized the ASIC regulates the flow of power and controls the data processing. The thermistor provides an output over normal operating ranges that is proportional to the external air temperature. The voltage output is processed in the analogue to digital converter and stored by the communications ASIC. It is transmitted to the control equipment when the device is interrogated. When a count of 55 is exceeded the alarm flag is initiated and the device address is added to the data stream every 32 polling cycles from its last polling for the duration of the alarm level condition, except when an alarming device is being interrogated. This can provide a location identified alarm from any device on the loop in approximately two seconds.

Environmental characteristics

The XP95 Heat Detector range is unaffected by wind or atmospheric pressure. Standard detectors operate over the temperature range -20°C to $+70^\circ\text{C}$.

EMC Directive 2014/30/EU

The XP95 Heat Detector complies with the essential requirements of the EMC Directive 2014/30/EU, provided that it is used as described in this datasheet.

A copy of the Declaration of Conformity is available from Apollo upon request.


Conformity of the XP95 Heat Detector with the EMC Directive, does not confer compliance with the directive on any apparatus or systems connected to it.

Construction Products Regulation 305/2011/EU

The XP95 Heat Detector complies with the essential requirements of the Construction Products Regulation 305/2011/EU.

A copy of the Declaration of Performance is available from Apollo upon request.

XP95 Heat Detector dimensional drawing

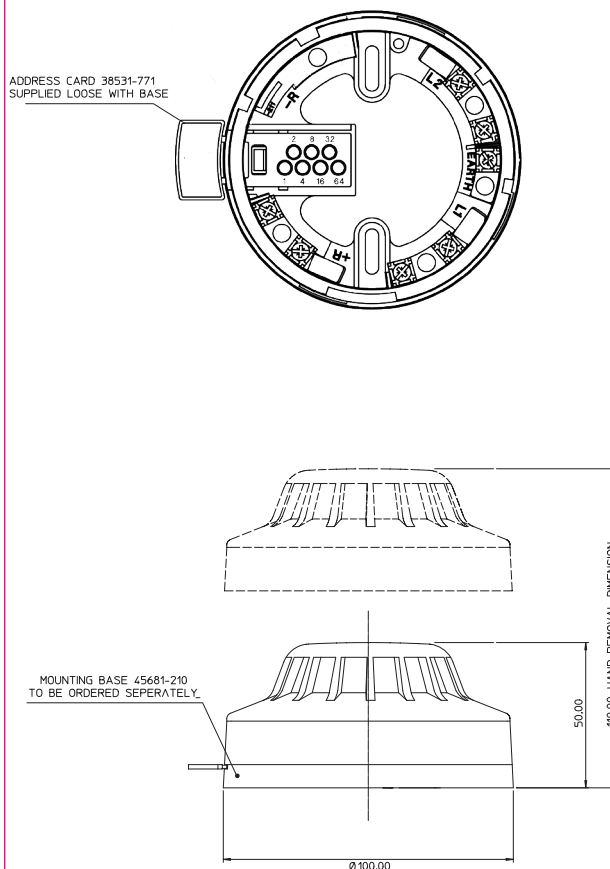

XP95 Heat Detector sectional diagram

